

REVISION

ZONE	REV	DESCRIPTION	DATE	CHANGED BY	APPROVED
	A	INITIAL RELEASE	09/20/2024	HBAKKE	GUTTADAURO

F


F

E


E

D


D



NEMA 5/15P
HOSPITAL GRADE
BLACK



C13
IEC60320
BLACK

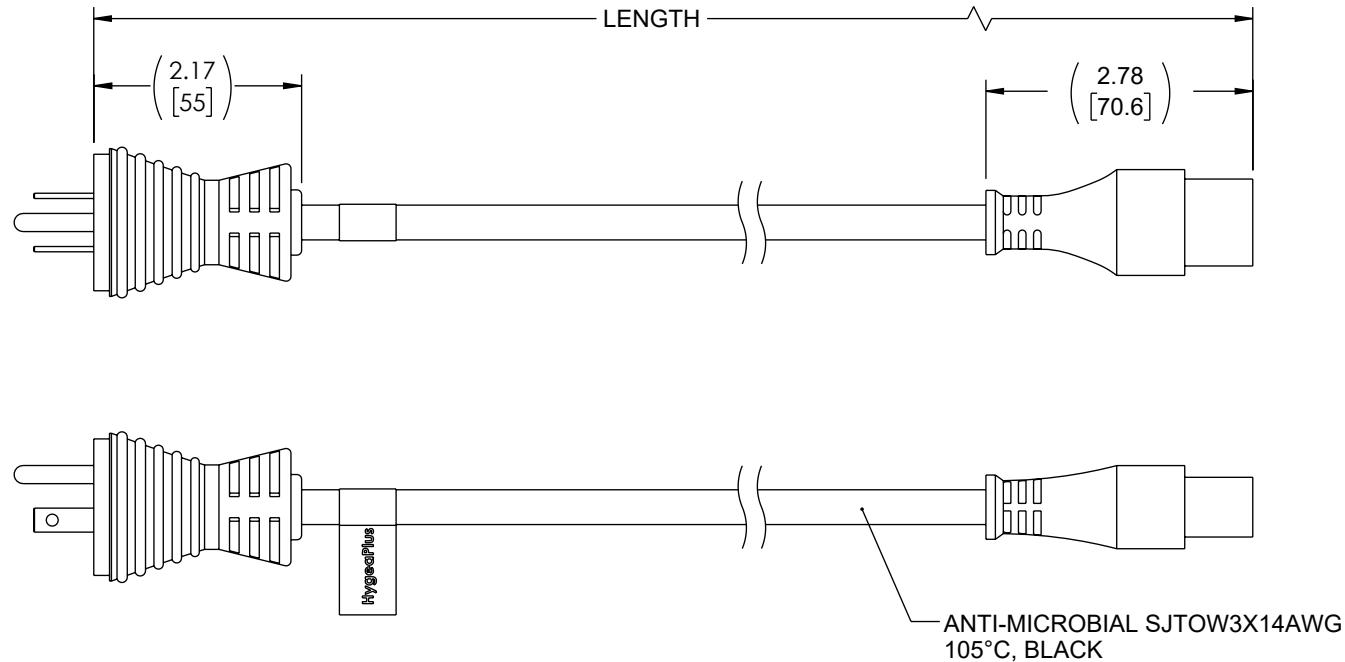

NOTES:

UL FILE: E234956

RATING: 15A

1. CABLE ASSEMBLY SHALL BE TESTED FOR CONTINUITY.
2. CABLE ASSEMBLY SHALL BE INDIVIDUALLY PACKAGED.

REGULATORY COMPLIANCE:

EU RoHS DIRECTIVE (MOST RECENT RELEASED VERSION)

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF INFINITE ELECTRONICS, INC. ANY REPRODUCTION IN PART OR WHOLE WITHOUT THE WRITTEN PERMISSION OF INFINITE ELECTRONICS, INC. IS PROHIBITED. THESE COMMODITIES, TECHNOLOGY OR SOFTWARE WERE EXPORTED FROM THE UNITED STATES IN ACCORDANCE WITH THE EXPORT ADMINISTRATION REGULATIONS. DIVERSION CONTRARY TO U.S. LAW PROHIBITED.

ITEM NUMBER	LENGTH, FT [mm]	TOLERANCE
TTA00069-3F	3.0 [914.4]	± .79 [20.1]
TTA00069-6F	6.0 [1828.8]	± .79 [20.1]
TTA00069-10F	10.0 [3048]	± .79 [20.1]
TTA00069-15F	15.0 [4572]	± .79 [20.1]

UNLESS OTHERWISE SPECIFIED
LEADING DIMENSIONS ARE INCHES
DIMENSIONS IN [] ARE MILLIMETERS

TOLERANCES:
 $X = \pm .2$ [5] FRACTIONS
 $XX = \pm .02$ [0.5] $\pm 1/32$
 $XXX = \pm .005$ [0.13] ANGLES $\pm 1^\circ$

CABLE LENGTH TOLERANCES:
 ≤ 12 [305] $= +1$ [25] / -0
 > 12 [305] ≤ 60 [1524] $= +2$ [51] / -0
 > 60 [1524] ≤ 120 [3048] $= +4$ [102] / -0
 > 120 [3048] ≤ 300 [7620] $= +6$ [152] / -0
 > 300 [7620] $= +5\% / -0$

ALL DIMENSIONS ARE FOR REFERENCE ONLY
AND SUBJECT TO CHANGE WITHOUT NOTICE
UN-DIMENSIONED/NON-CRITICAL FEATURES
MAY VARY IN SIZE AND LOCATION
COLORS MAY VARY



an INFINITE® brand
Website: www.Transtector.com
Phone: 1.800.882.9110 | 1.208.635.6400



SCALE NONE SHEET 1 OF 1

DESCRIPTION HG N5-15P TO C13, ANTIMICROBIE JKT, 15 A

SIZE	CAGE CODE	DRAWN BY	ITEM NO.	REV
A	30992	HBAKKE	TTA00069	A